



NOTES:

- 1) Verify that each component requiring or supplying power has been configured for proper system voltage before applying power.
- 2) All wires to be 18 awg 500' max unless otherwise noted.
- 3) All line voltage power to be I/A/W local electrical code.
- 4) All wires to be stranded copper unless overridden by local electrical code.

With EPT
 14 AWG - 75ft max
 12 AWG - 80ft max
 10 AWG - 125ft max



12 AWG THHN
 80 ft max
 with wire loop

POWER TRANSFERS

NOTE:

Optional power transfers are available. Please note variations in wire size and maximum run length for these options.


- 14 AWG - 40 ft max
- 12 AWG - 60 ft max
- 10 AWG - 100 ft max



NOTE: Make certain to maintain consistent wire color across the transfer to maintain polarity.

Function Statement:

- From exterior- locked condition:** Access via valid credential.
- From exterior - unlocked condition:** Doors to remain locked unless held unlocked via access control.
- From interior - locked condition:** Free egress via exit device.
- From interior - unlocked condition:** Free egress via exit device.
- General:** This is a basic wiring diagram. For a project specific wiring diagram contact your Kawneer representative.

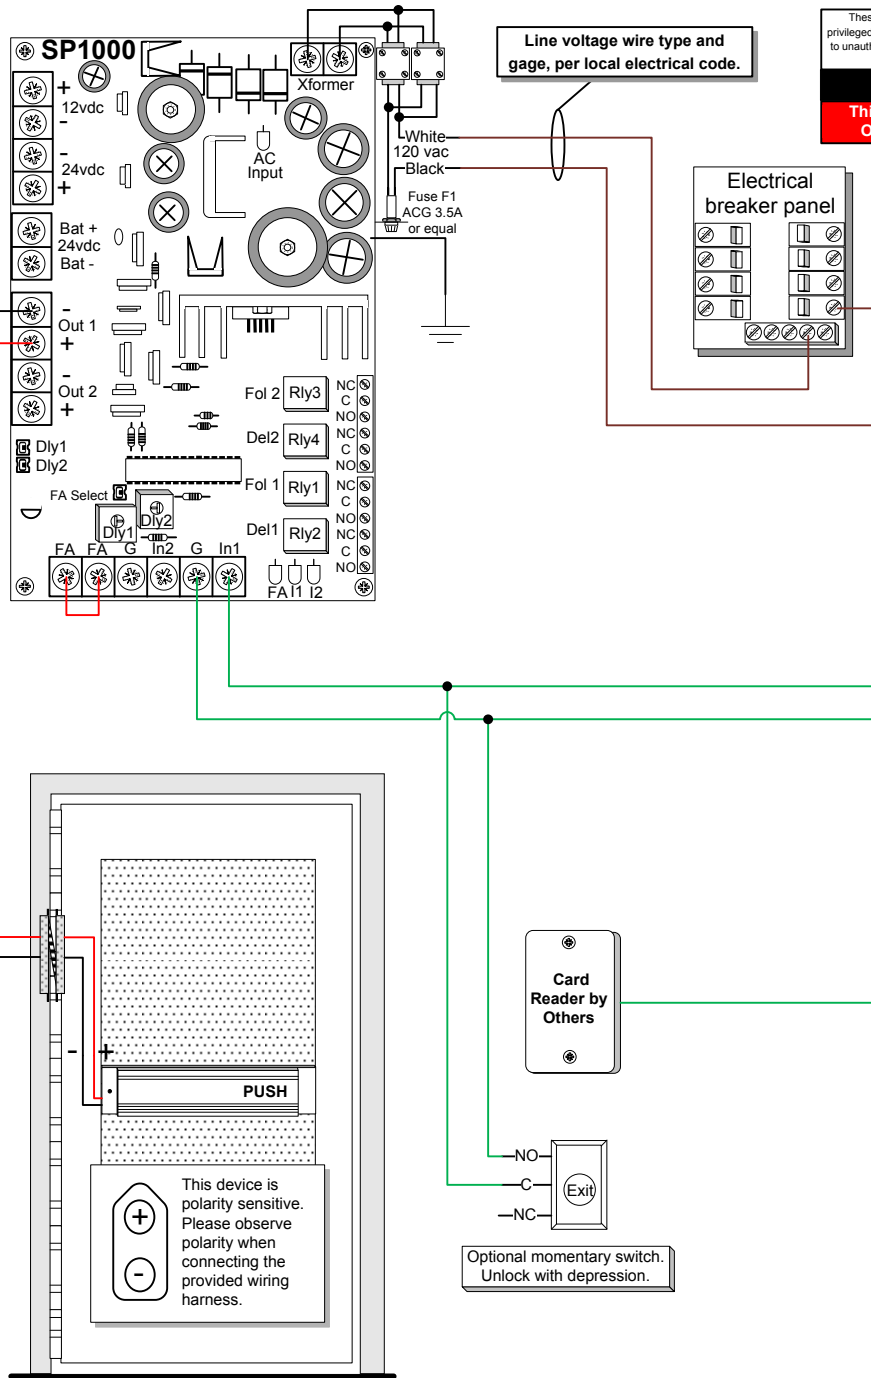


These drawings are the sole and exclusive property of Special Projects Group and contain sensitive privileged or confidential information which may be used only for its benefit. The disclosure of these drawings to unauthorized persons is strictly prohibited. This document and all copies must be returned upon demand. COPYRIGHT © 2009 SPECIAL PROJECTS GROUP, INC.

FOR REFERENCE ONLY

This drawing is not a substitute for qualified field technicians. One hour of telephone support is available without charge.

Special Projects Group
 (888) 284-4774

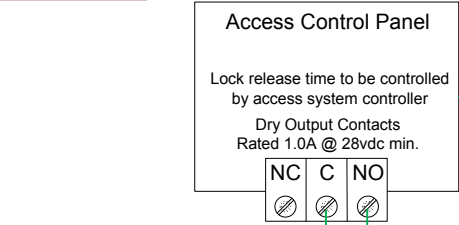

Optional momentary switch. Unlock with depression.

Title: Paneline EL Exit Device 1 Single.vsd	Project: Paneline EL 1 single door
Heading: Paneline EL	Door: Kawneer Paneline
Date: 1/21/2009	Date Printed: 1/21/2009 Last Revised: 01/20/2009 2:41:34 PM
Drawn By: Patrick Treleven	For: Kawneer Company Inc. Pg: 1 OF 1